
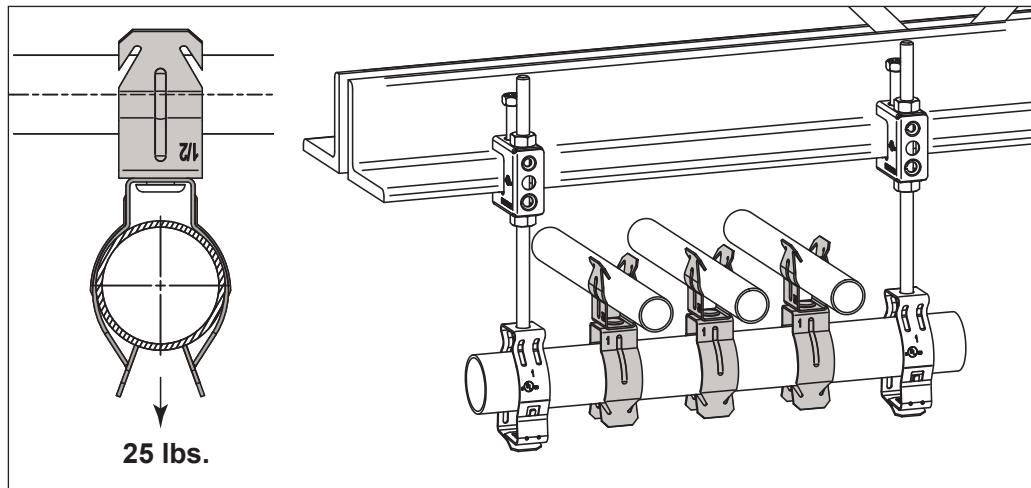


## Conduit and Cable Supports

## CCP CCP

Conduit "Push In" Clip with Conduit  
"Push In" Clip

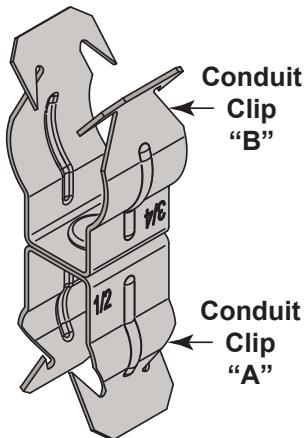

- No tools required for conduit installation.
- For lightweight trapeze systems.
- Conduit clips rotate 360 degrees.
- **Material:** Spring Steel
- **Finish:** Silva-Guard

Part No.	Conduit Clip "A"	Conduit Clip "B"
CCP8CCP8		1/2" EMT
CCP8CCP12	1/2" EMT	3/4" EMT, 1/2" Rigid
CCP8CCP16		1" EMT, 3/4" Rigid
CCP12CCP12	3/4" EMT, 1/2" Rigid	3/4" EMT, 1/2" Rigid
CCP12CCP16		1" EMT, 3/4" Rigid
CCP16CCP16	1" EMT, 3/4" Rigid	1" EMT, 3/4" Rigid

## Finish or Material Order Codes

Material/Finish	ASTM Designation	Material/Finish Codes	Description
Carbon Steel	ASTM A1011-00 SS GR 33 or ASTM A1011-00CS Type B	See Finishes Below	Steel
Spring Steel	ASTM A684 Grade 1055	See Finishes Below	Cold rolled Spring Steel sheet
Silva-Guard	--	SG	Silva-Guard coating is a multi-step process that meets the 1000 hour salt spray test per ASTM B117 and DIN 50021. Silva-Guard coating is WEEE, ELV and RoHS compliant. SG Finish is approved for outdoor as well as indoor applications. It is a chrome free duplex coating system that combines an inorganic zinc-rich base coat with an aluminum-rich organic topcoat.
Electroplated	ASTM B 633 SC1 or SC3, Type III	EG	This coating is standard for most products. Electroplating deposits zinc on the surface of the steel by electrolysis from a bath of zinc salts.
Pre-Galvanized	A 653 SS GR33 G90.	PG	Pre-galvanized zinc is produced by continuously rolling steel coils or sheets through molten zinc at the mills.

## PROJECT INFORMATION:

## APPROVAL STAMP:

Project:

Date:

Phone:

Architect / Engineer:

Contractor:

Address:

Notes 1:

CCP-CCP

H08/24 - 53



**WARNING:** Cancer and Reproductive Harm Warning.  
For more information go to [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov).

[www.ZSIINC.com](http://www.ZSIINC.com)
